



ADDENDUM NO. 1

To Contract Documents for:

**BURIAL VAULTS AND COLUMBARIUM NICHE WALLS
NORTHERN MAINE VETERANS' MEMORIAL CEMETERY
CARIBOU, MAINE**

Owner:

State of Maine
Department of Defense, Veterans and Emergency Management
Bureau of Maine Veterans' Services

Project Designer and Engineer:

Walsh Engineering Associates, Inc.
One Karen Drive, Suite 2A
Westbrook, ME 04092

Date: MAY 5, 2015

This Addendum modifies, amends and supplements designated parts of the Contract Documents, Project Manual and Drawings dated April 24, 2015 and is hereby made a part thereof by reference and shall be as binding as though inserted in its entirety in the locations specified herein. It shall be the responsibility of the Contractor to notify all Subcontractors and Suppliers of any changes or modifications contained in this addendum.

Acknowledge receipt of this Addendum on the Bid Form. Failure to do so may result in disqualification of the Bid.

CHANGES TO THE CONTRACT DOCUMENTS


Item No. Section/Sheet No. Description

- C1.01 **Design Change:** To facilitate winterization of the irrigation system, the routing of the ¾” waterline from the pump to the control panel has been revised and additional valves and valve boxes have been added. Also, the control panel has been relocated in the garage.
Specifications: Replace Appendix D of the specifications with the attached Appendix D dated May 5, 2015.
- C1.02 **Contractor Question:** “: There is a detail for sod on the plans. Is there any area(s) on the job that requires sod?”
Clarification: The area over the burial crypts and out to ten (10) feet on all sides and all the disturbed areas around the columbariums shall be sodded.
- C1.03 **Design Change:** The detail for pavement thickness of the access road was omitted from the plans.
Plans: See sheet C5.5 dated May 5, 2015 attached to this addendum.

END OF ADDENDUM #1

GENERAL NOTES:

1. THE CONTRACTOR SHALL BE RESPONSIBLE FOR NOTIFYING "DIG SAFE" AND LOCAL UTILITY COMPANIES AT LEAST THREE (3) BUSINESS DAYS, BUT NOT MORE THAN 30 CALENDAR DAYS, PRIOR TO THE COMMENCEMENT OF ANY EXCAVATION, IN ACCORDANCE WITH MAINE STATE LAW. "DIG SAFE" TELEPHONE NUMBER IS 1-888-344-7233.
2. CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS SHOWN ON THE DRAWINGS. IF ANY DISCREPANCIES ARE FOUND, THE OWNER OR OWNER'S REPRESENTATIVE SHALL BE NOTIFIED IMMEDIATELY.
3. ALL WORK TO BE PERFORMED BY A LICENSED ELECTRICIAN. ALL MATERIALS AND INSTALLATION TO BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE, EMERA MAINE STANDARDS AND CITY OF CARIBOU REQUIREMENTS.
4. ELECTRIC SERVICE FOR PUMP SHALL BE 6/3 WIRE IN 2" CONDUIT WITH WARNING TAPE, IRRIGATION SYSTEM DECODER WIRE SHALL BE 1 4/2, DIRECT BURY, WATERLINE TO CONTROL PANEL SHALL BE 3/4" HDPE IRRIGATION PIPE.
5. CONTRACTOR TO PROVIDE VALVES AND 10" ROUND VALVE BOXES AT HIGH AND LOW POINTS IN 3/4" WATERLINE TO ALLOW FOR WINTERIZING LINE.
6. INSTALL SECOND, EMPTY 2" CONDUIT WITH WARNING TAPE AND PULL STRING FROM PUMP CONTROL PANEL TO 5' BEYOND EDGE OF ROAD PAVEMENT IN SAME TRENCH AS OTHER LINES, CAP BOTH ENDS.

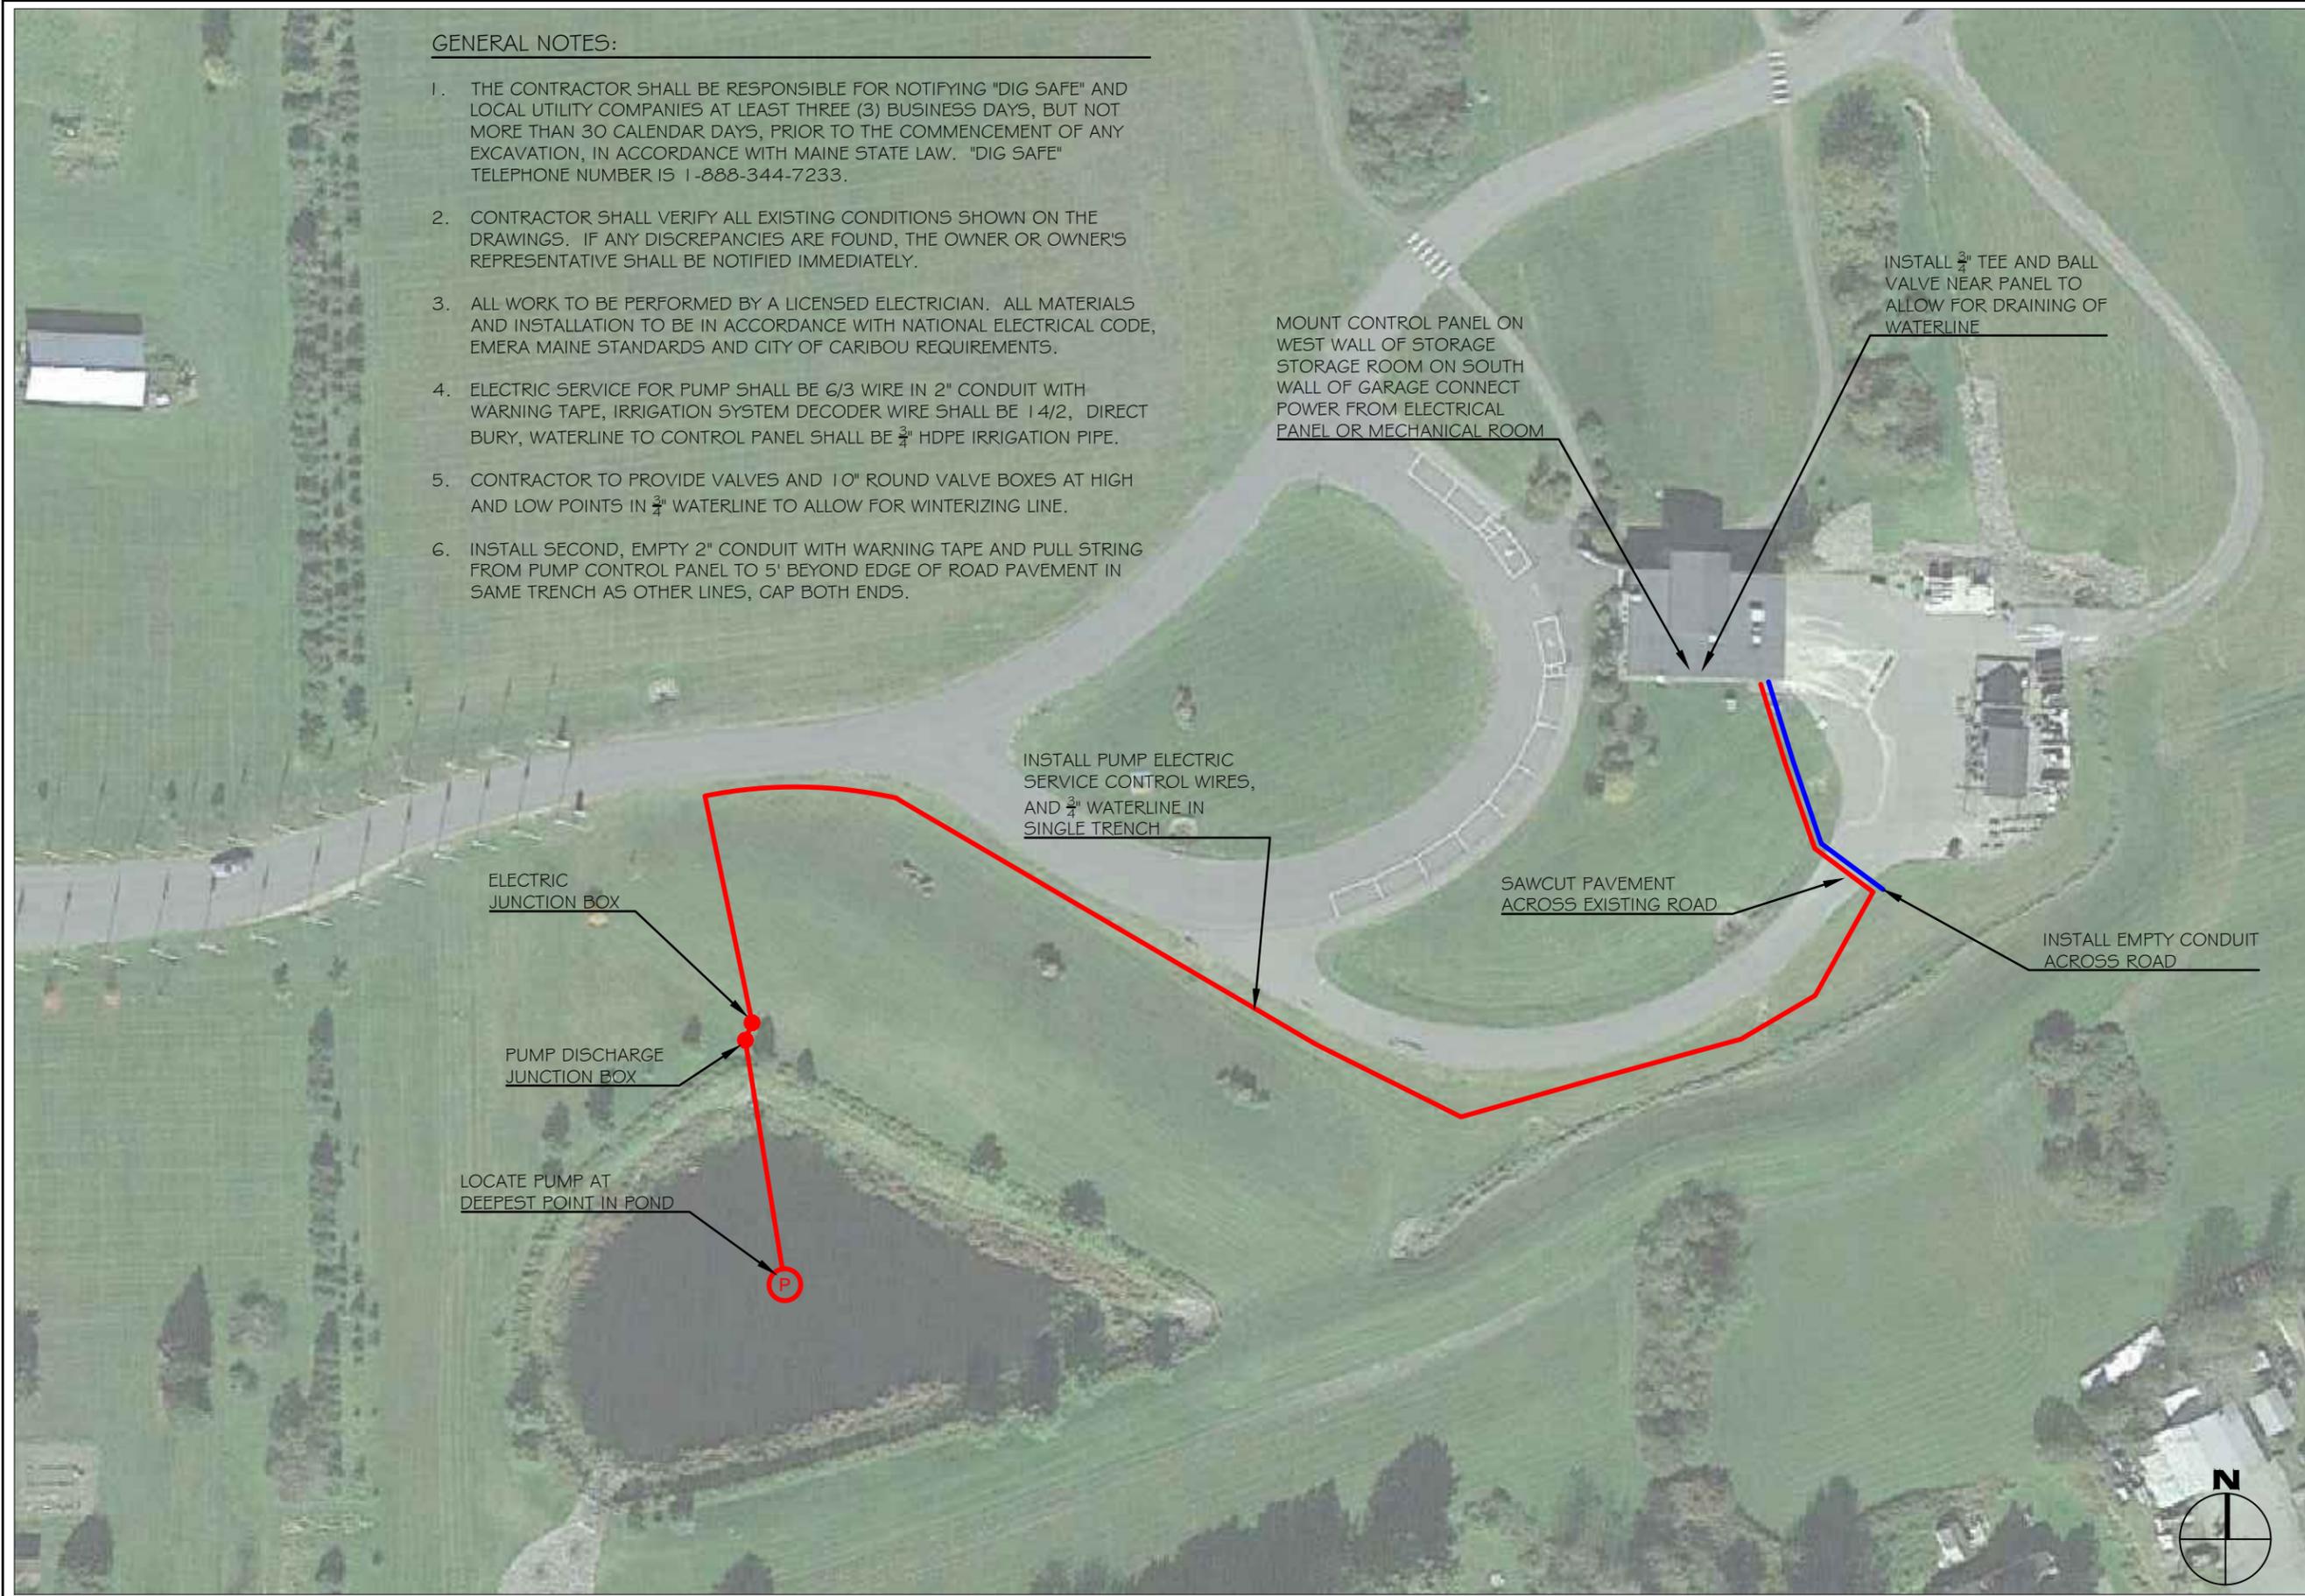

Sheet Number:

Appendix D

Sheet Title:
Pump Control &
Electric Service
Schematic Plan

Job No.: 112CBV
Date: May 5, 2015
Scale: NONE
Drawn: NGC
Checked: WRW


Burial Crypts; Section L & Columbarium Niche Wall Expansion

Northern Maine Veterans' Memorial Cemetery
37 Lombard Road
Caribou, Maine

WALSH ENGINEERING ASSOCIATES, INC.

One Karen Dr., Suite 2A | Westbrook, Maine 04092
ph: 207.553.9898 | www.walsh-eng.com

Copyright © 2015

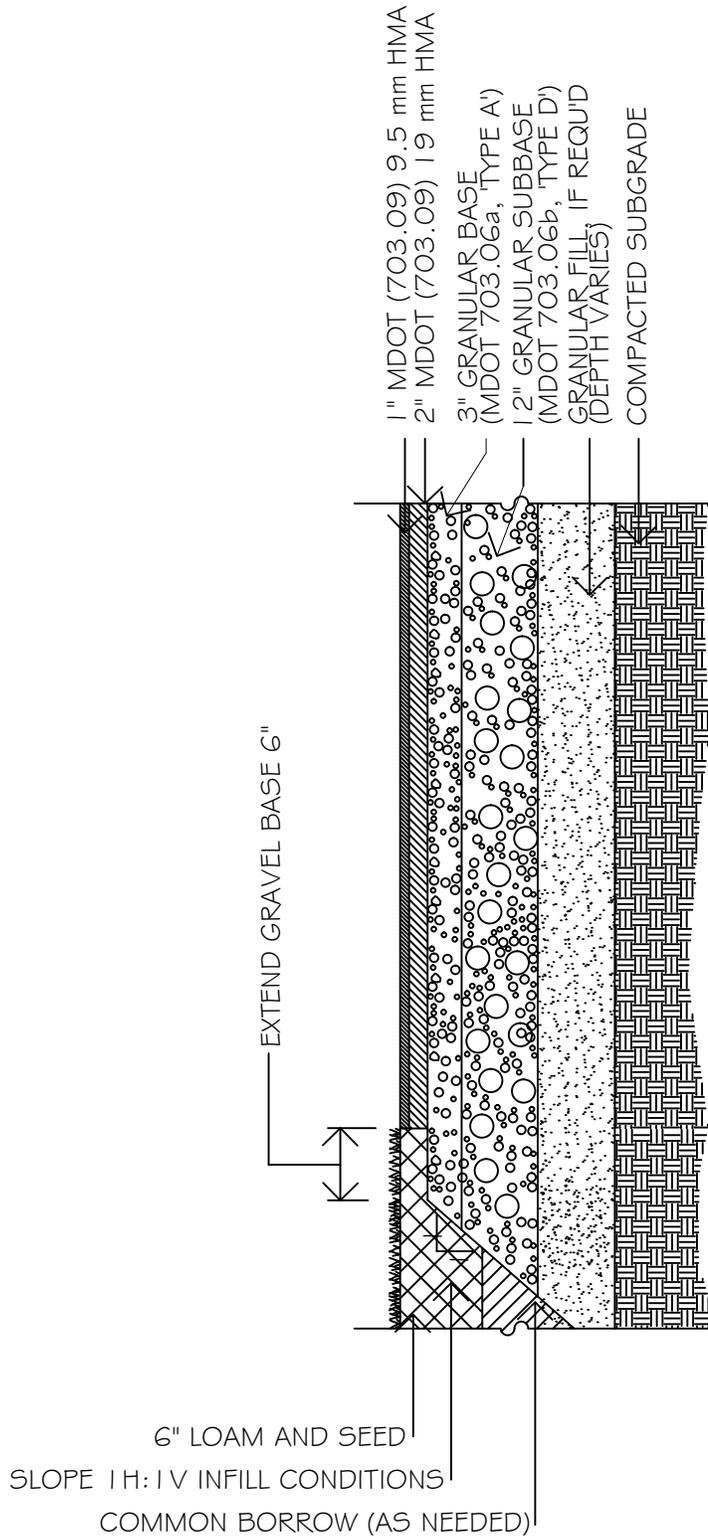

1 ACCESS ROAD PAVEMENT SECTION

NOT TO SCALE

1
 C5.5

WALSH
 ENGINEERING ASSOCIATES, INC.

One Karen Dr., Suite 2A | Westbrook, Maine 04092
 ph: 207.553.9898 | www.walsh-eng.com

Copyright © 2015

Northern Maine Veterans' Memorial Cemetery

37 Lombard Road
 Caribou, Maine

Sheet Title:

C5.5

Job No.: 112CBV

Date: MAY 15, 2015

Scale: 1" = 2,000'

Drawn: NGC

Checked: WRW